


CURRENT IN AMPERES



CLEARING TIME CURRENT CHARACTERISTIC CURVES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	5.5kV E-RATED 10E-600E

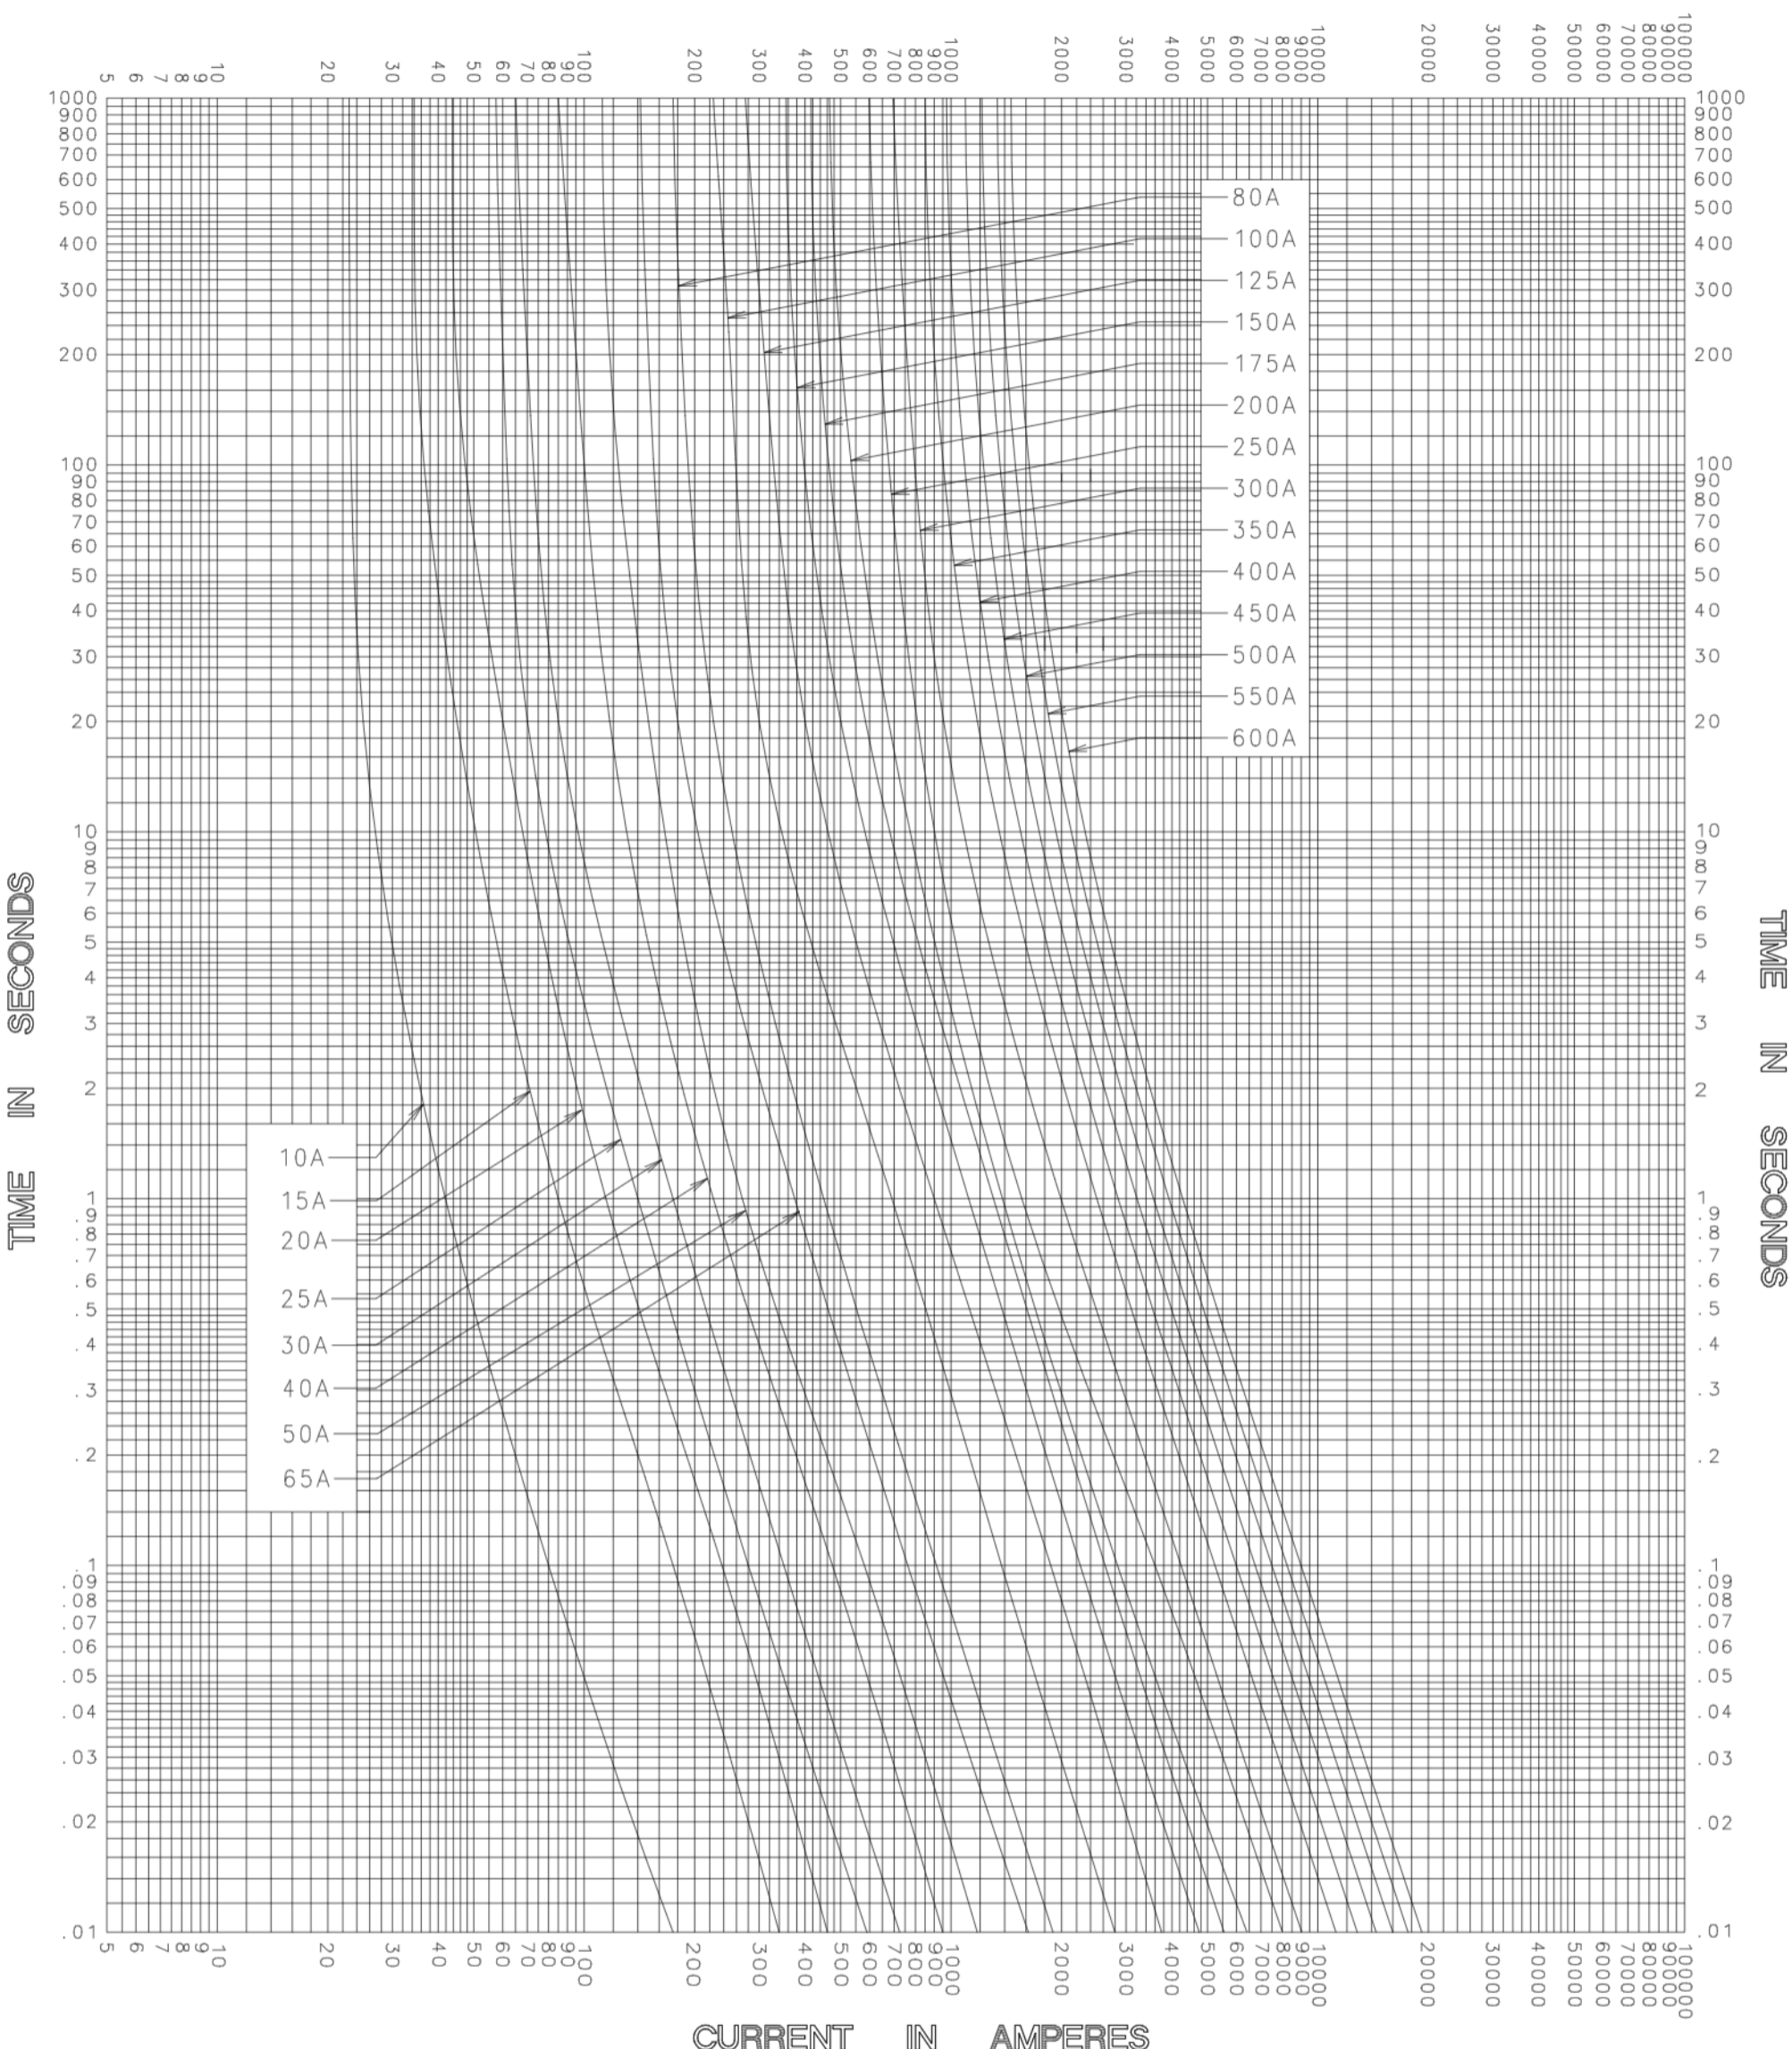

LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 07/23/04
CHECKED BY MP
DRAWING NO. B-FCC0551001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

