
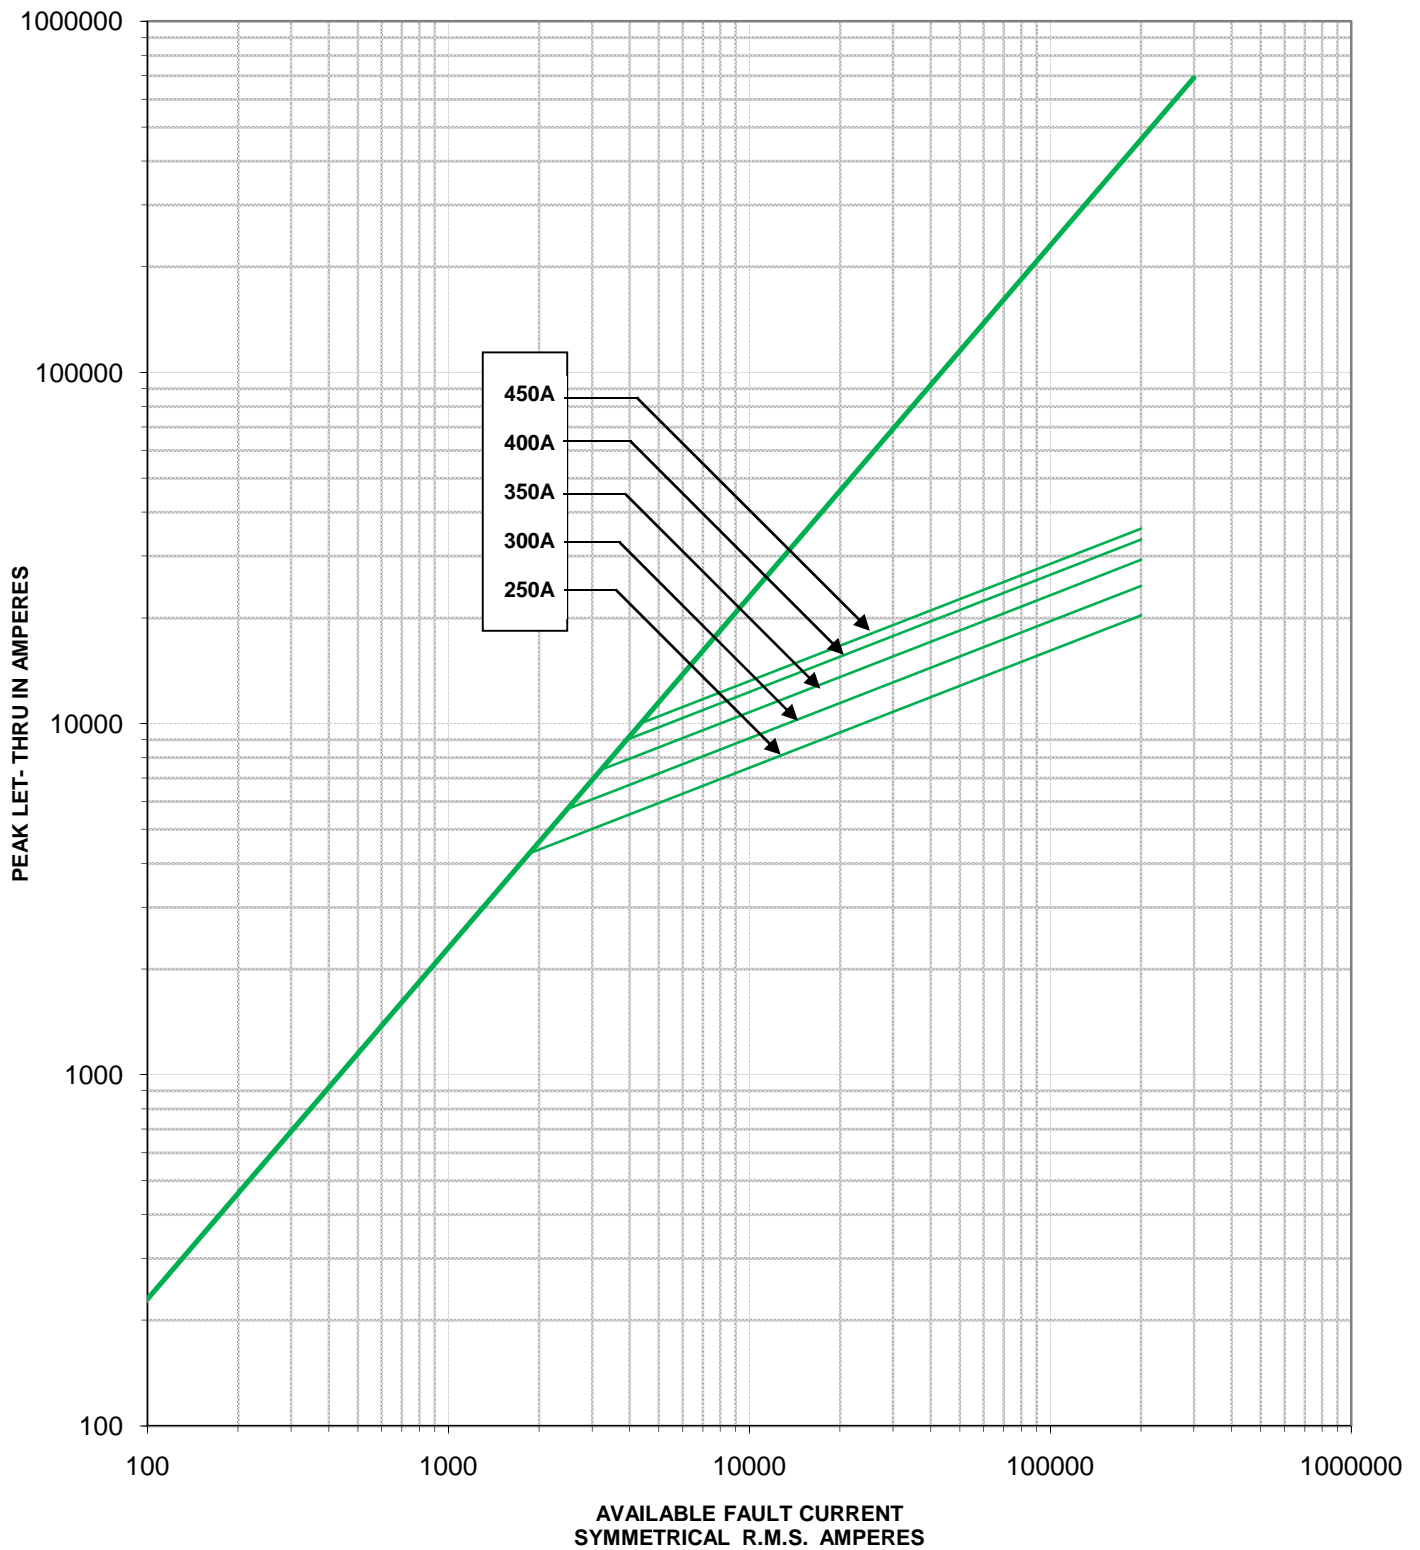



TEST VOLTAGE: 600 Vac	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		SPFJ 125A-450A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL USA		DRAWN BY: NCS DATE: 4/27/2011 REVISION: A
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 2 of 3 FCC05-SPFJ



TEST VOLTAGE: 600 Vac	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		SPFJ 125A-450A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL USA		DRAWN BY: NCS DATE: 4/27/2011 REVISION: A
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 3 of 3 FCC05-SPFJ