


CURRENT IN AMPERES



CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 8.25kV E-RATED 100E-400E
BASIS FOR DATA _____		

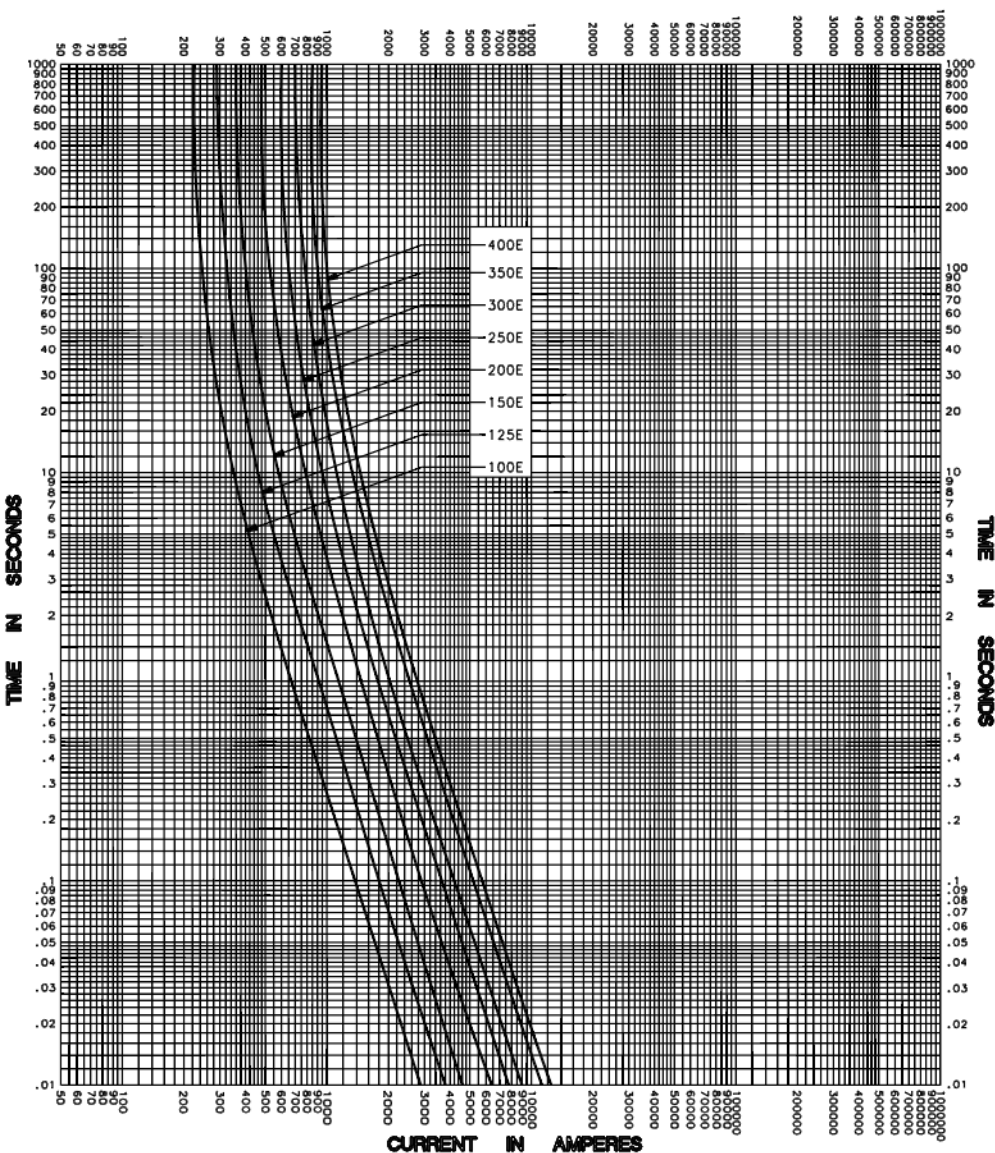

DRAWN BY <u>LLL</u>
DATE <u>07/26/04</u>
CHECKED BY <u>MP</u>

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC-002

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT