
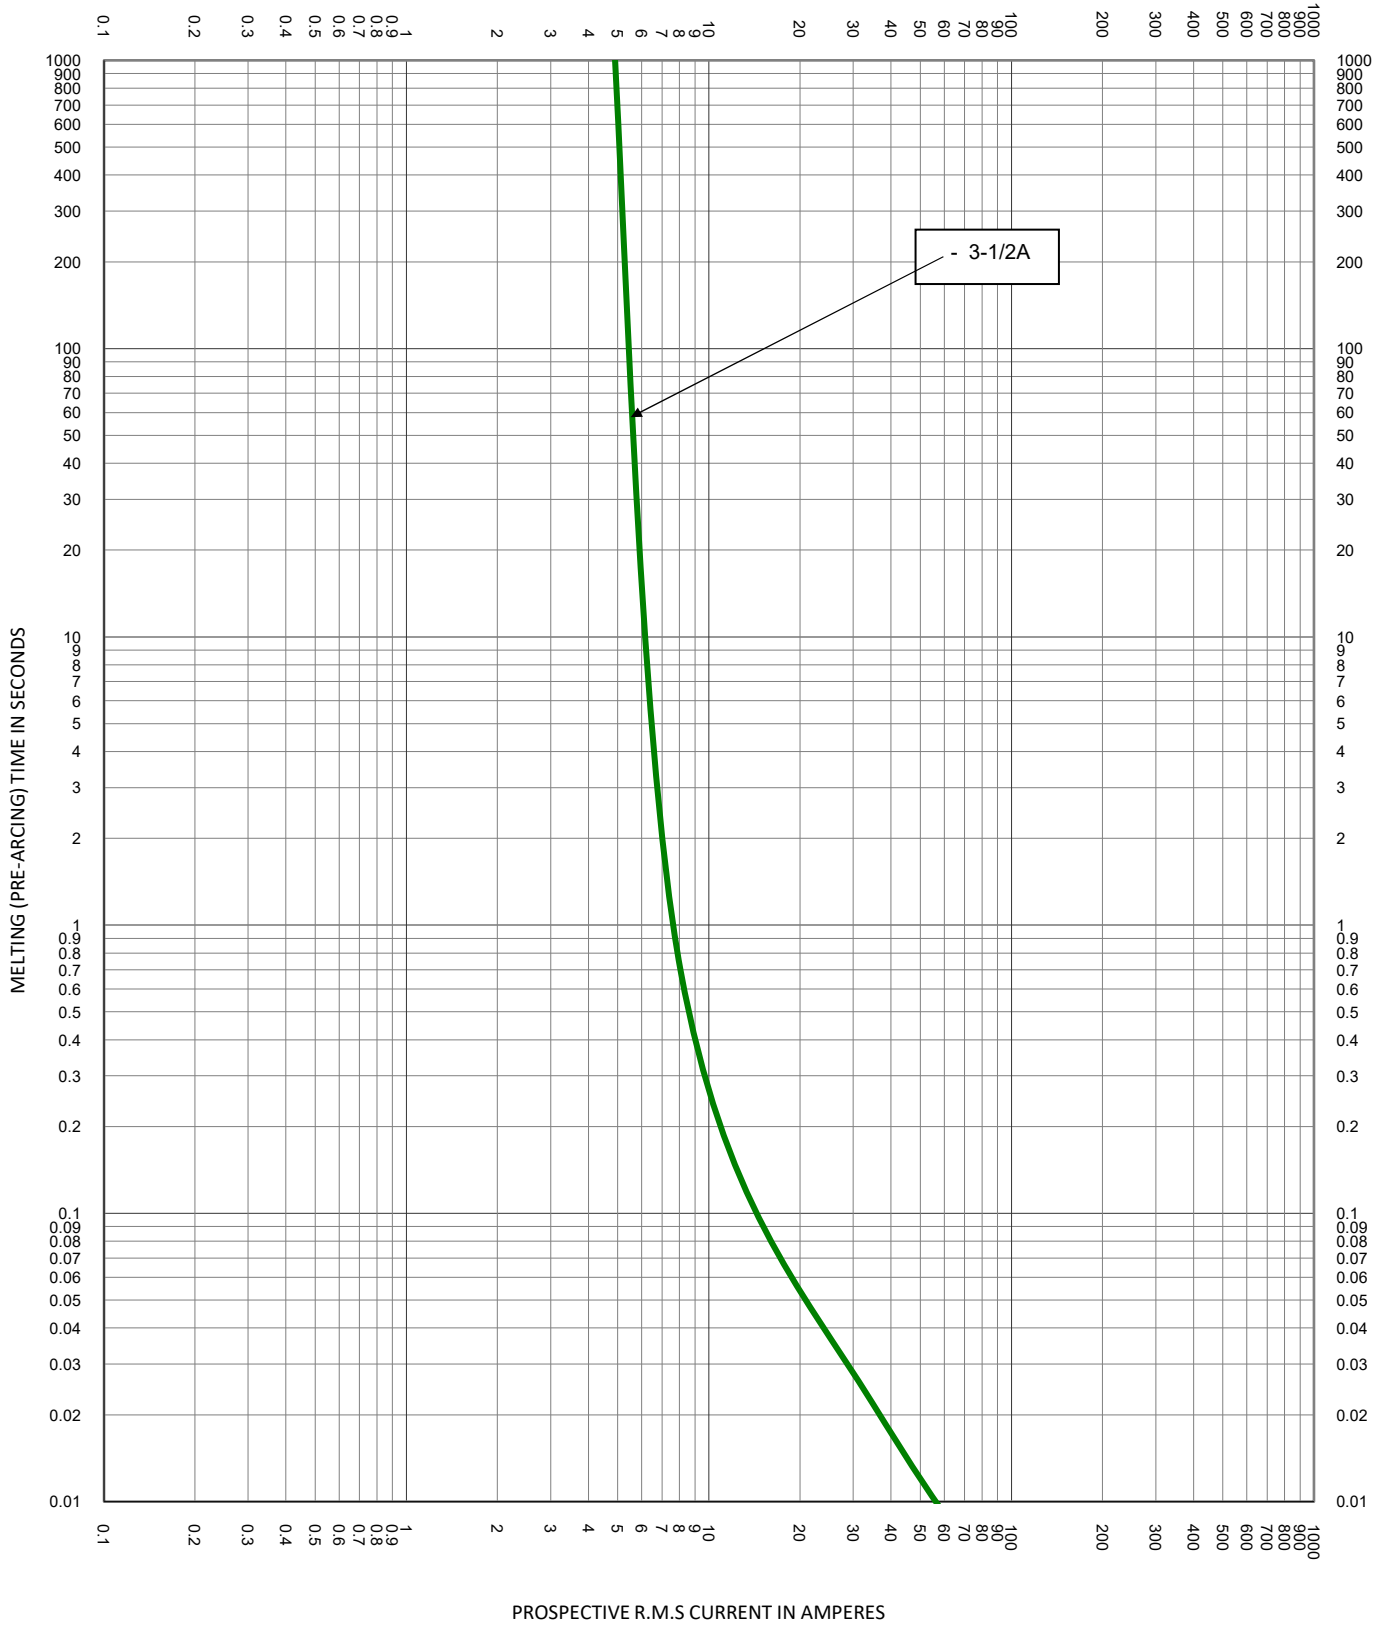



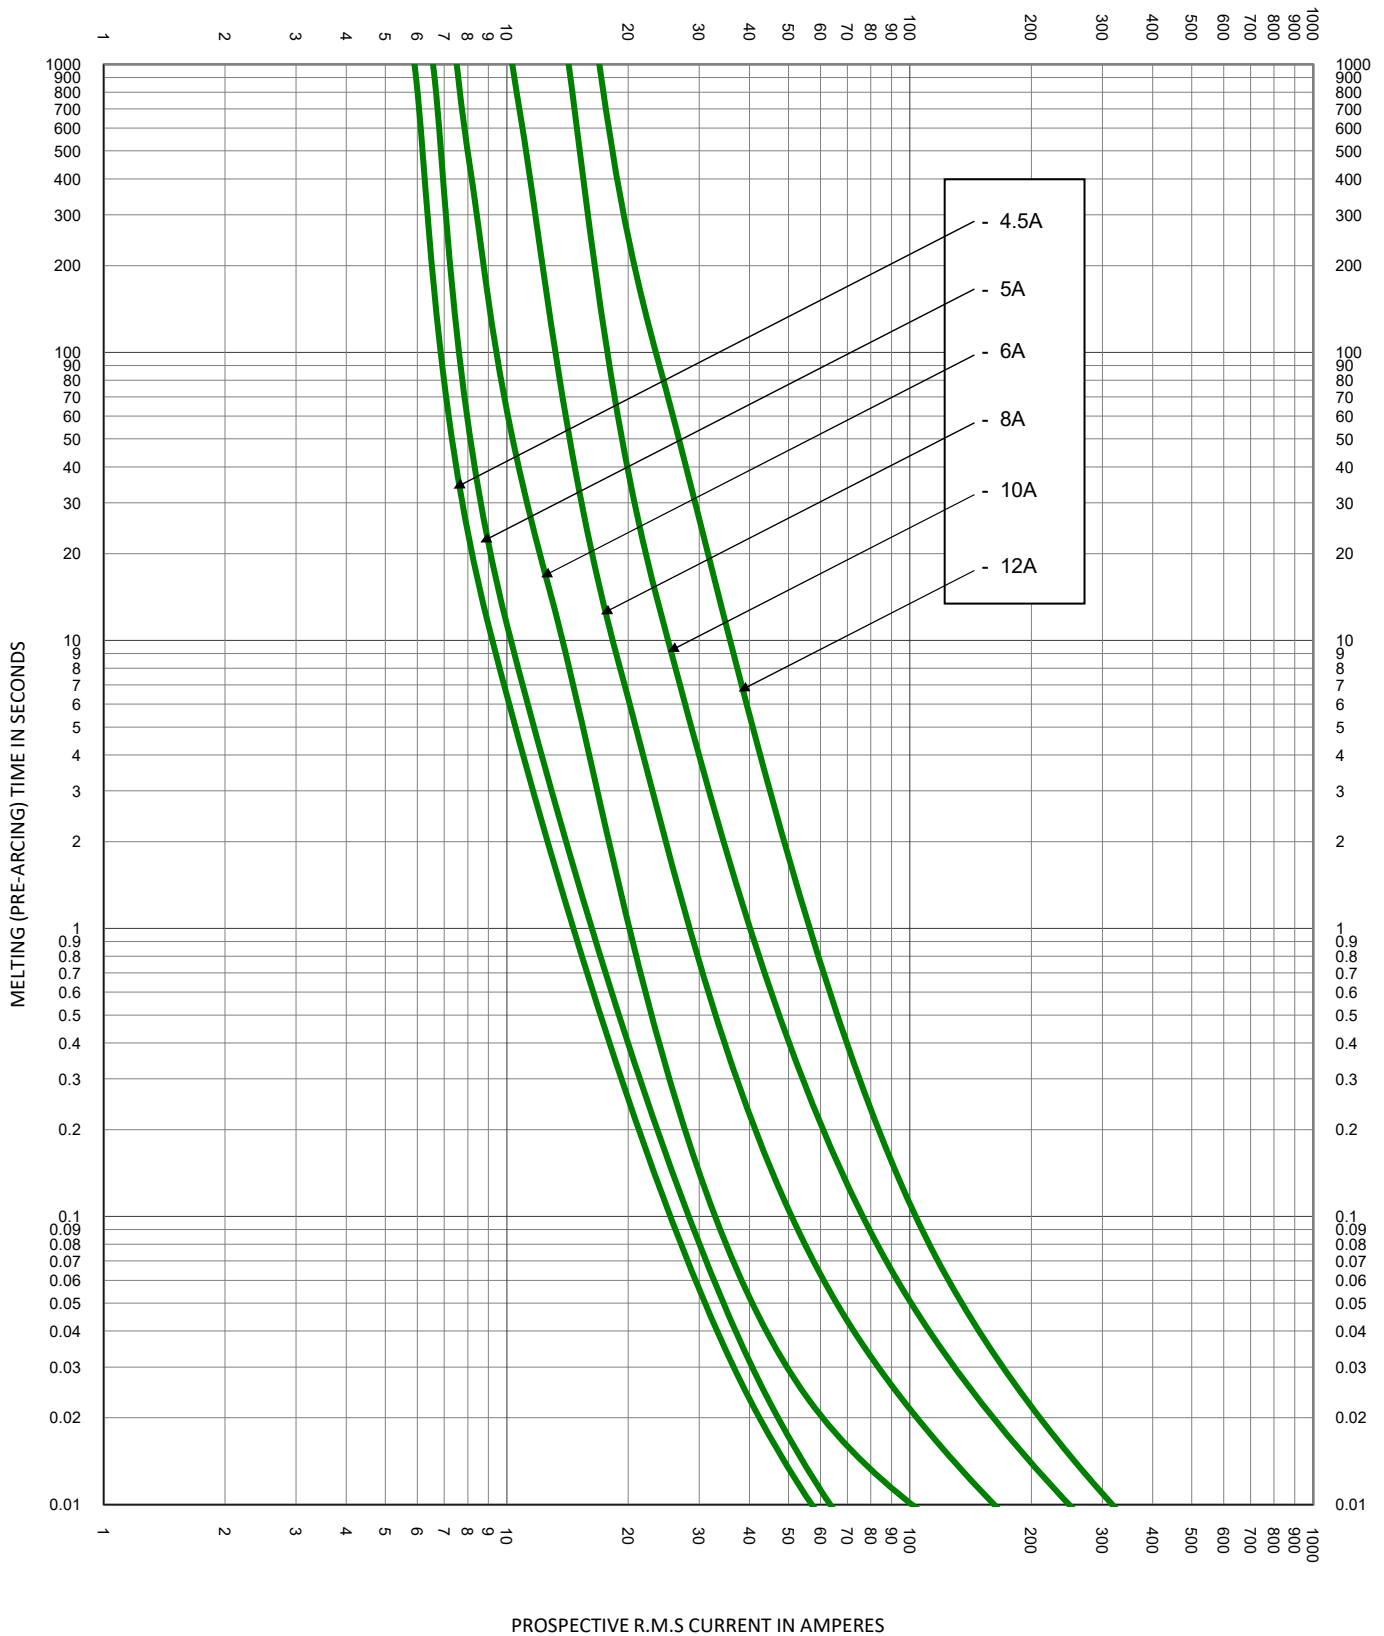
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A


 LITTELFUSE, INC. CHICAGO, IL, USA	DRAWN BY: LLL DATE: 08/10/2020 REVISION: H
	DRAWING NO.: SHEET 2 OF 6 FCC01-SPXI


TIME CURRENT CHARACTERISTIC CURVES




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A
		DRAWN BY: LLL
		DATE: 08/10/2020
TIME CURRENT CHARACTERISTIC CURVES		REVISION: H
		DRAWING NO.: SHEET 3 OF 6
		FCC01-SPXI




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A
		DRAWN BY: LLL DATE: 08/10/2020 REVISION: H
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 4 OF 6 FCC01-SPXI

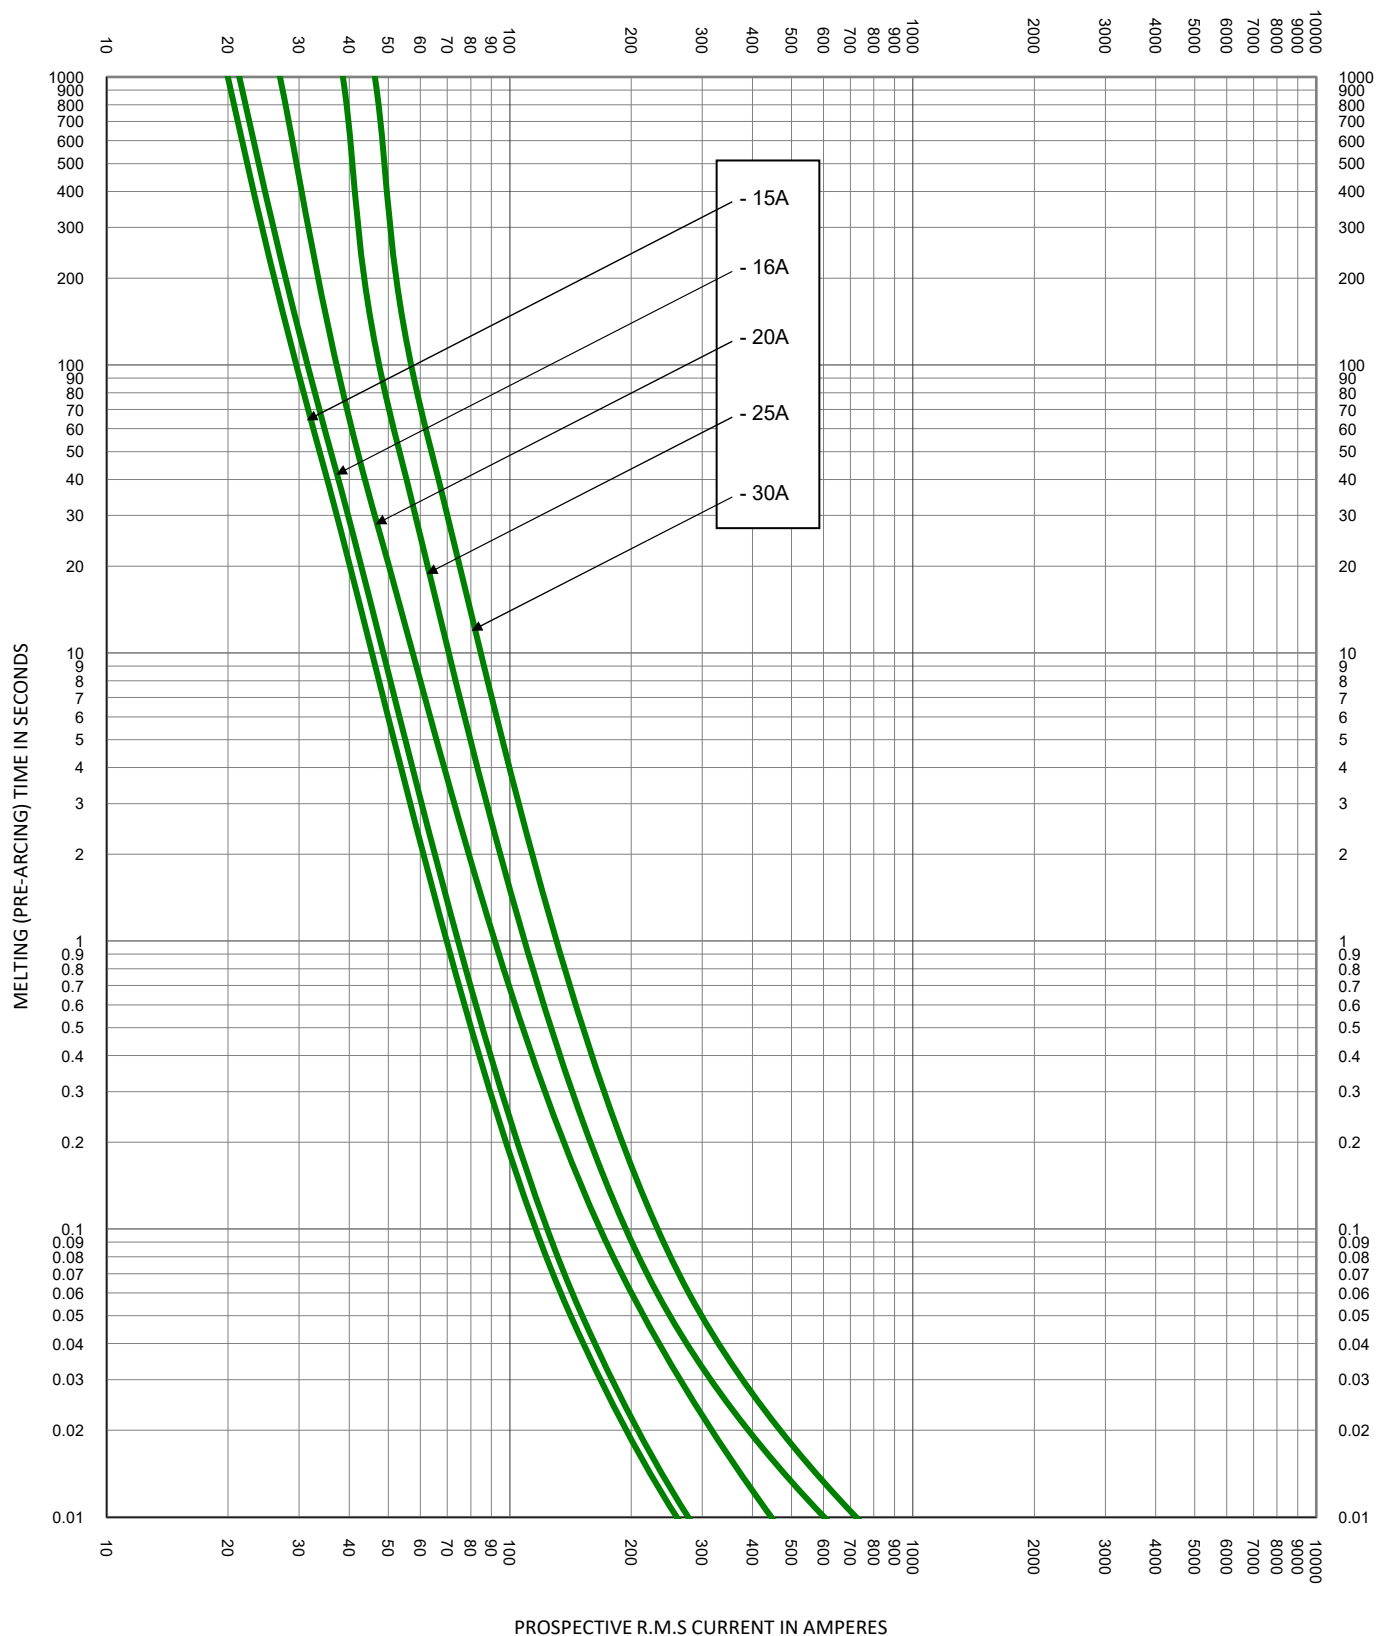


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 LITTELFUSE, INC. CHICAGO, IL, USA	DRAWN BY: LLL DATE: 08/10/2020 REVISION: H
	TIME CURRENT CHARACTERISTIC CURVES
DRAWING NO.: SHEET 5 OF 6	
FCC01-SPXI	

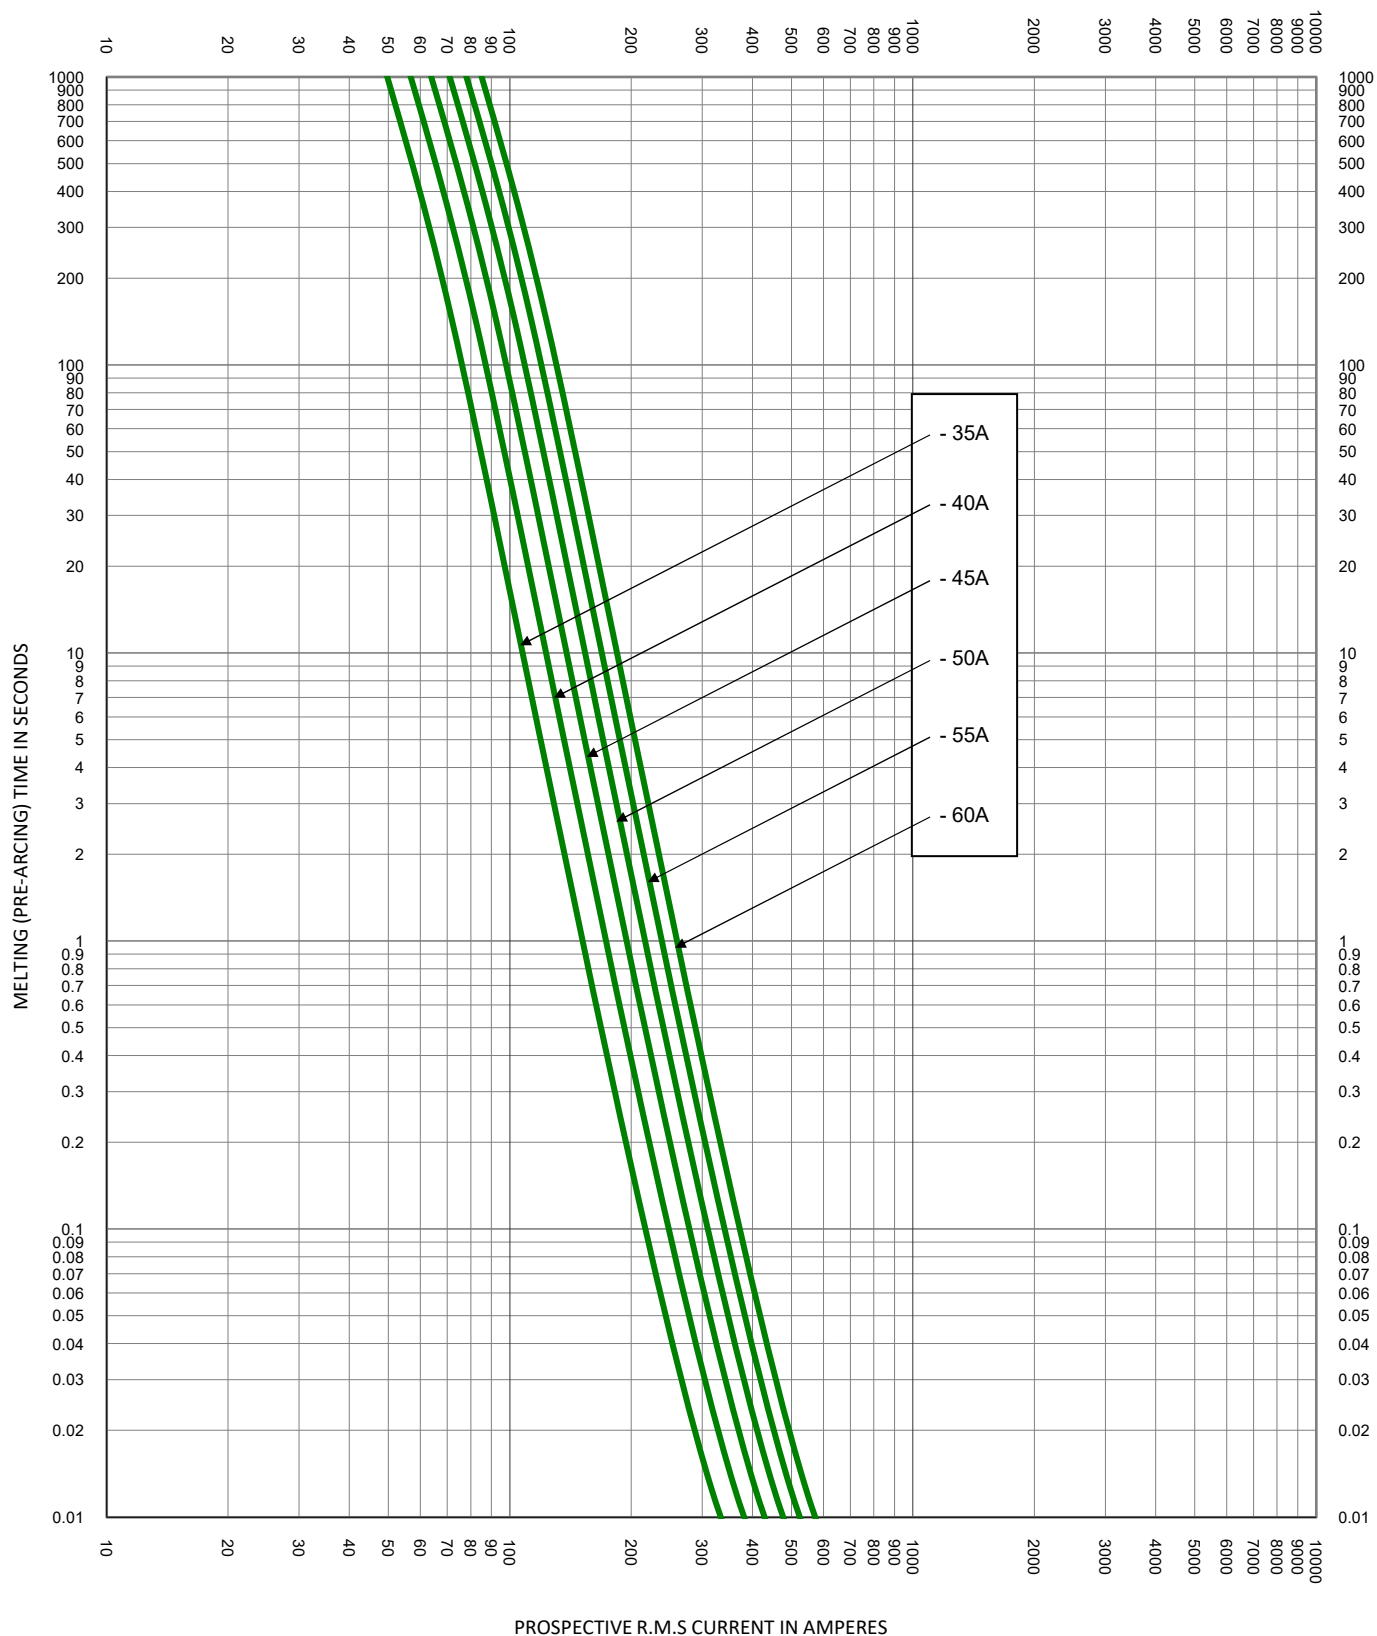

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A

 LITTELFUSE, INC. CHICAGO, IL, USA	DRAWN BY: LLL DATE: 08/10/2020 REVISION: H
	DRAWING NO.: SHEET 6 OF 6 FCC01-SPXI

TIME CURRENT CHARACTERISTIC CURVES